

Cement Board System with Integral Continuous Insulation and Adhered Veneer Typical 2D Details







### Typical Details 2D

### **Table of Contents**

1. Application over Framing (Isometric)

2. Application over Framing (Plan View)

3. Window Jamb Detail with Casing Bead (Plan View)

4. Window Jamb Detail with Backwrap (Plan View)

5. Window Head Detail with Starter Track

6. Window Head Detail with Backwrap

7. Window Sill Detail with Casing Bead

8. Window Sill Detail with Backwrap

9. Expansion Joint at Floor Line with Casing Bead

10. Expansion Joint at Floor Line with Backwrap

11. Drainage at Floor Line with Starter Track and Casing Bead

12. Drainage at Floor Line with Backwrap

13. Vertical Expansion Joint with Casing Bead (Plan View)

14. Vertical Expansion Joint with Backwrap (Plan View)

15. Acrylic Finish to Adhered Veneer Transition

16. Light Fixture

17. Pipe Penetration

18. Sign Attachment

19. Outside Corner Miter Detail (Plan View)

20. Outside Corner Detail Rabbet Joint (Plan View)

21. Inside Corner Detail

22. Fascia/Soffit

23. Termination at Foundation

24. Metal Coping Detail

25. Termination Above Flat Roof


#### **Notes:**

- The details within are the latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The
  details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown,
  consult Sika for review of specific details.
- Install Sika materials in accordance with current installation instructions.
- · Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.
- Adhered veneer shall not exceed 15 lbs. (6.8 kg) per sq. ft.





### **TYPICAL APPLICATION OVER FRAMING (ISOMETRIC)**

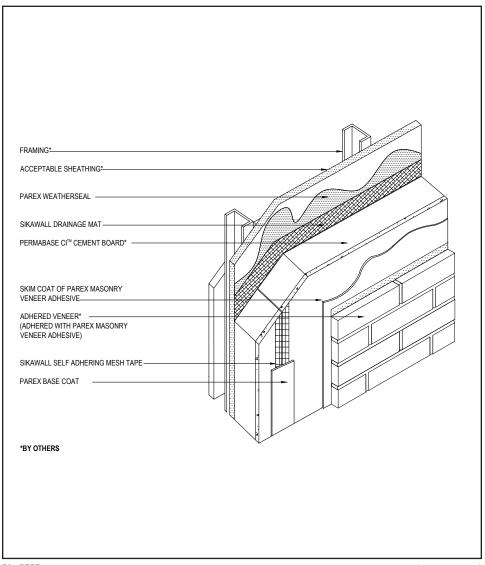

Adhered veneer shall not exceed 15 lbs. (6.8 kg) per sq. ft.


01 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### **TYPICAL APPLICATION OVER FRAMING (PLAN VIEW)**

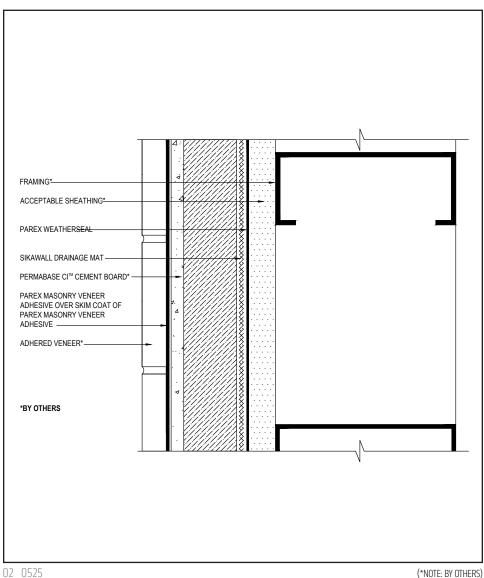

• Adhered veneer shall not exceed 15 lbs. (6.8 kg) per sq. ft.

(\*NOTE: BY OTHERS)

The details within are the latest recommendations and are represented in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


Technical Service







## TYPICAL WINDOW JAMB DETAIL WITH CASING BEAD (PLAN VIEW)

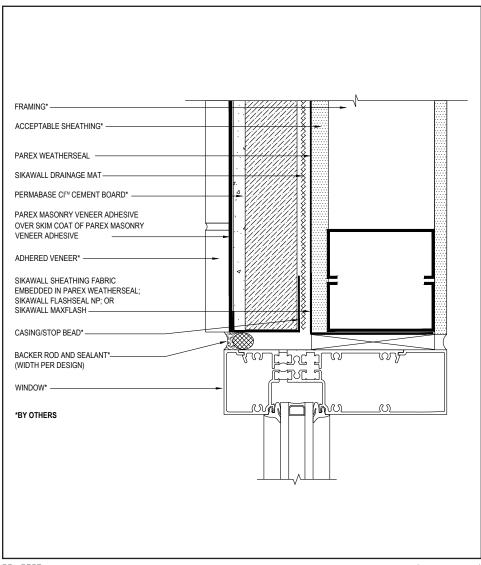

- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details for further information.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

03 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







## TYPICAL WINDOW JAMB DETAIL WITH BACKWRAP (PLAN VIEW)

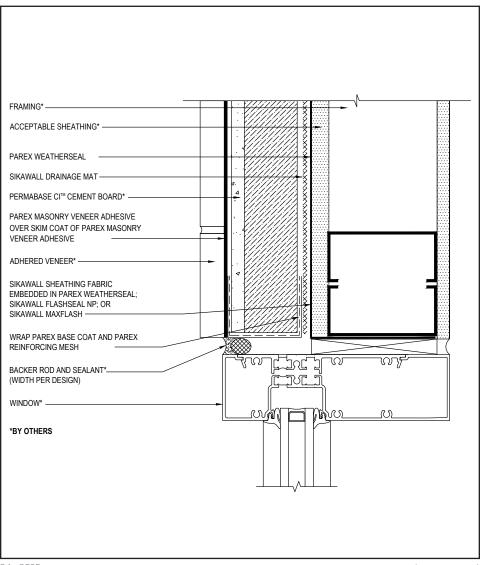

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details for further information.
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.


04 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL WINDOW HEAD DETAIL WITH STARTER TRACK

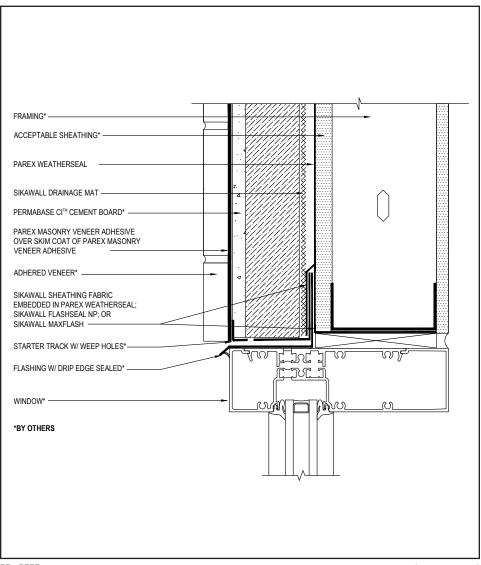

- Provide end-dams at flashing terminations.
- Ensure a means for drainage is provided at system termination at window head.
- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details.
- · Ensure a starter track with weep holes is used.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

05 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.






# Sika<sup>®</sup>

## Parex NuTech Stucco MVS CI

### TYPICAL WINDOW HEAD DETAIL WITH BACKWRAP

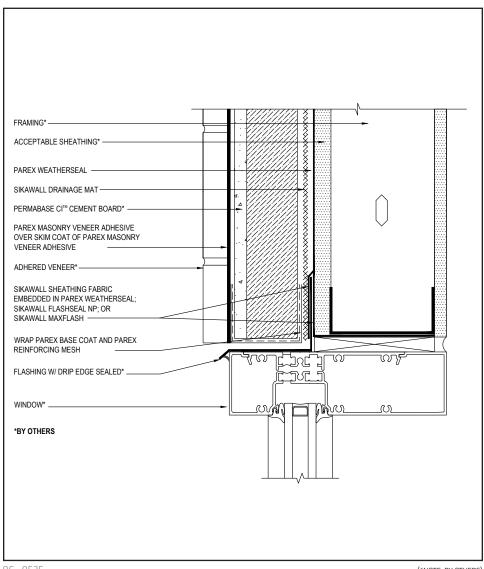

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details for further information.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.
- Provide end-dams at flashing terminations.
- Ensure a means for drainage is provided at system termination at window head.

06 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL WINDOW SILL DETAIL WITH CASING BEAD

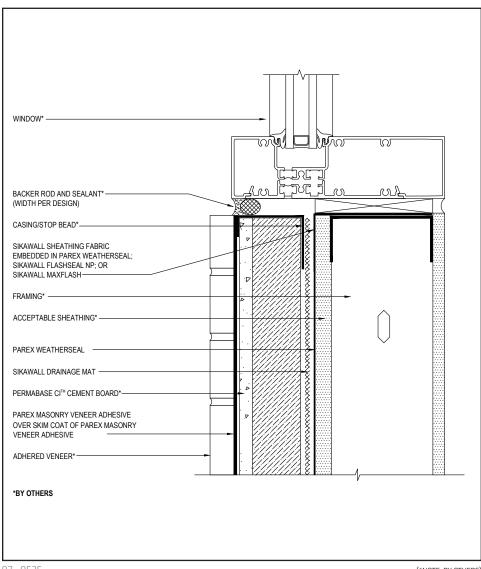

- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details for further information.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

07 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL WINDOW SILL DETAIL WITH BACKWRAP

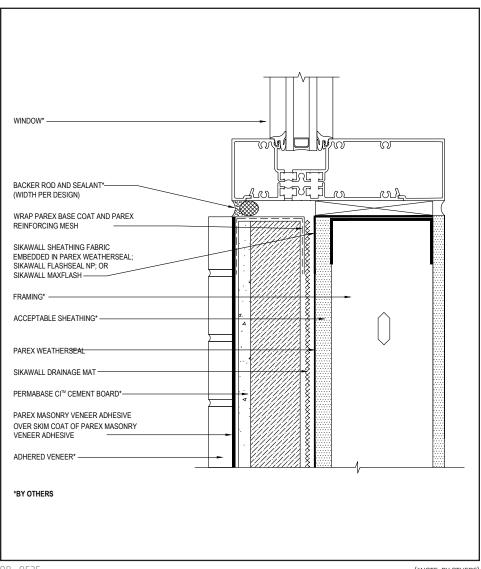

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Prior to window and SikaWall Drainage Mat installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with Parex application guidelines and code requirements. Reference Parex WeatherSeal published typical details for further information.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

08 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL EXPANSION JOINT AT FLOOR LINE WITH CASING BEAD

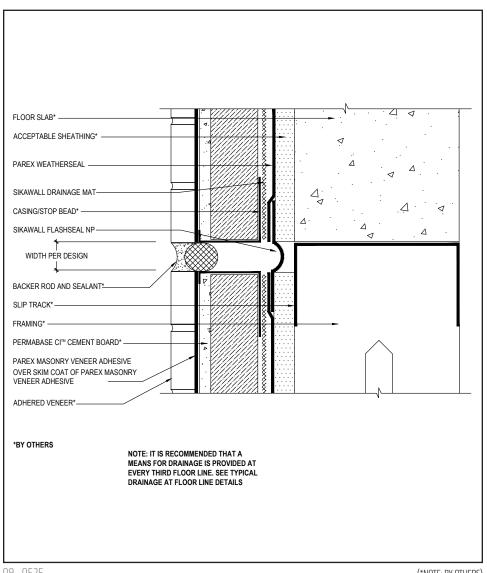

- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- Typical locations for system expansion
  joints are at building expansion joints, at
  prefabricated panel joints, floor lines of
  wood frame construction or where slip tracks
  are used in steel frame construction, where
  substrates change and where structural
  movement is anticipated. It is the sole
  responsibility of the project design team,
  including the architect, engineer, etc., to
  ultimately determine specific expansion joint
  placement, width and design. Detail specific
  locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.

09 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL EXPANSION JOINT AT FLOOR LINE WITH BACKWRAP

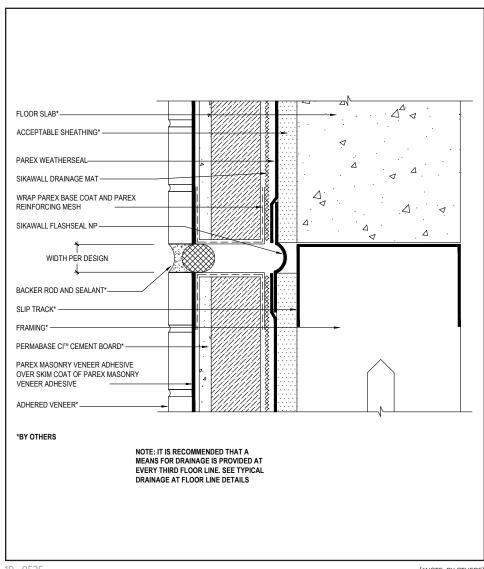

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- Typical locations for system expansion
  joints are at building expansion joints, at
  prefabricated panel joints, floor lines of
  wood frame construction or where slip tracks
  are used in steel frame construction, where
  substrates change and where structural
  movement is anticipated. It is the sole
  responsibility of the project design team,
  including the architect, engineer, etc., to
  ultimately determine specific expansion joint
  placement, width and design. Detail specific
  locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.

10 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







## TYPICAL DRAINAGE AT FLOOR LINE WITH STARTER TRACK AND CASING BEAD

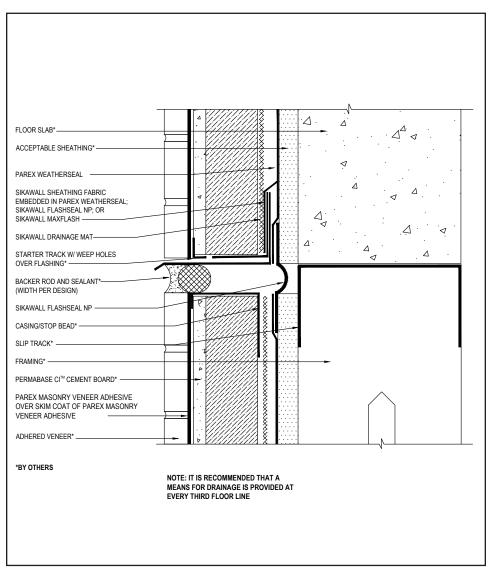

- Ensure a starter track with weep holes is used.
- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement
- Typical locations for system expansion
  joints are at building expansion joints, at
  prefabricated panel joints, floor lines of
  wood frame construction or where slip tracks
  are used in steel frame construction, where
  substrates change and where structural
  movement is anticipated. It is the sole
  responsibility of the project design team,
  including the architect, engineer, etc., to
  ultimately determine specific expansion joint
  placement, width and design. Detail specific
  locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.

11 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL DRAINAGE AT FLOOR LINE WITH BACKWRAP

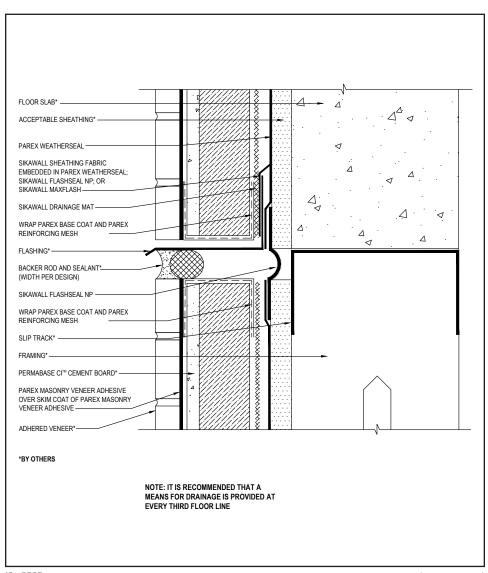

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- Typical locations for system expansion
  joints are at building expansion joints, at
  prefabricated panel joints, floor lines of
  wood frame construction or where slip tracks
  are used in steel frame construction, where
  substrates change and where structural
  movement is anticipated. It is the sole
  responsibility of the project design team,
  including the architect, engineer, etc., to
  ultimately determine specific expansion joint
  placement, width and design. Detail specific
  locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.

12 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







## TYPICAL VERTICAL EXPANSION JOINT WITH CASING BEAD (PLAN VIEW)

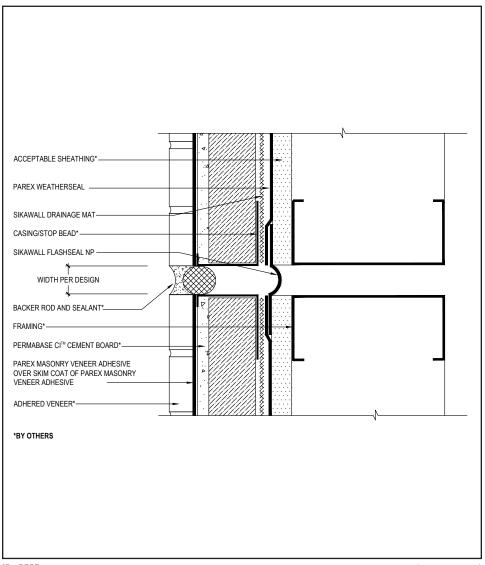

- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- Typical locations for system expansion
  joints are at building expansion joints, at
  prefabricated panel joints, floor lines of
  wood frame construction or where slip tracks
  are used in steel frame construction, where
  substrates change and where structural
  movement is anticipated. It is the sole
  responsibility of the project design team,
  including the architect, engineer, etc., to
  ultimately determine specific expansion joint
  placement, width and design. Detail specific
  locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.

13 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







## TYPICAL VERTICAL EXPANSION JOINT WITH BACKWRAP (PLAN VIEW)

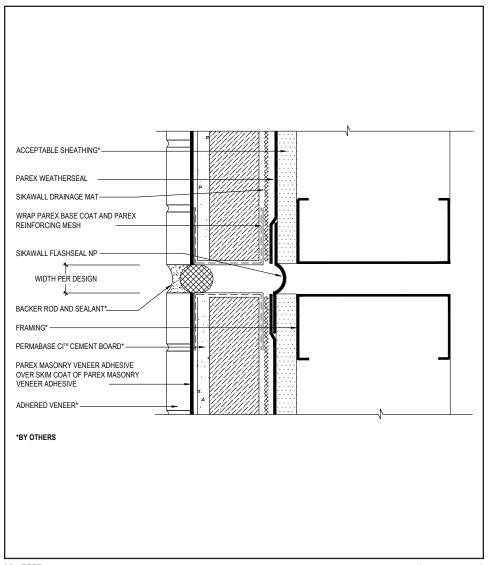

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- Typical locations for system expansion joints are at building expansion joints, at prefabricated panel joints, floor lines of wood frame construction or where slip tracks are used in steel frame construction, where substrates change and where structural movement is anticipated. It is the sole responsibility of the project design team, including the architect, engineer, etc., to ultimately determine specific expansion joint placement, width and design. Detail specific locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with Parex Wall Systems Technical Bulletin for a list of sealants.


14 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL ACRYLIC FINISH TO ADHERED VENEER TRANSITION

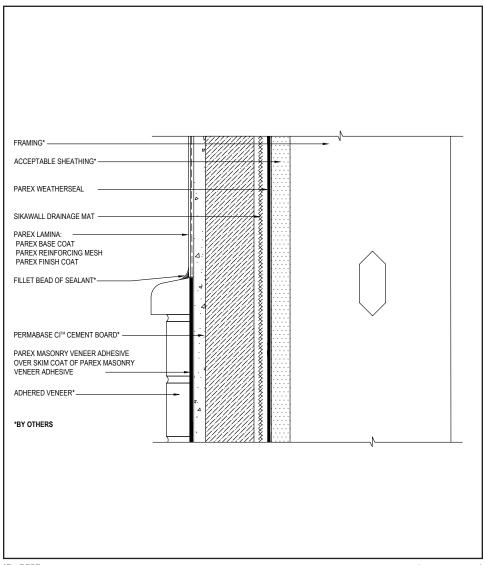

- Ensure all penetrations into the system are properly sealed.
- Provide continuous air seal around perimeter of penetration prior to SikaWall Drainage Mat application.


15 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





#### TYPICAL LIGHT FIXTURE

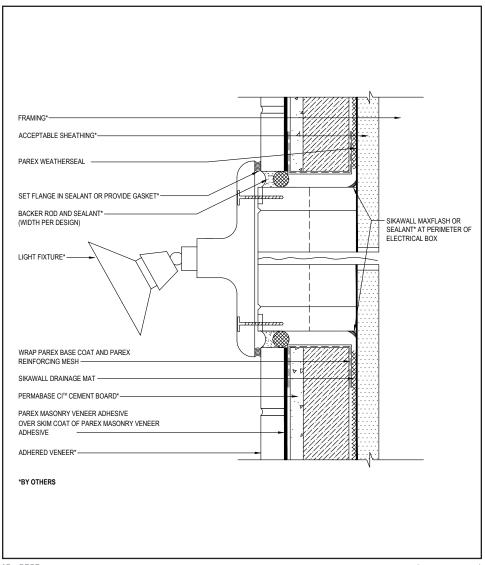

- Fully encapsulate system termination with mesh reinforced base coat. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure all penetrations into the system are properly sealed.
- Provide continuous air seal around perimeter of penetration prior to SikaWall Drainage Mat application.
- Reference Acceptable Sealants for use with WeatherSeal Technical Bulletin for a list of sealants.


16 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





#### TYPICAL PIPE PENETRATION

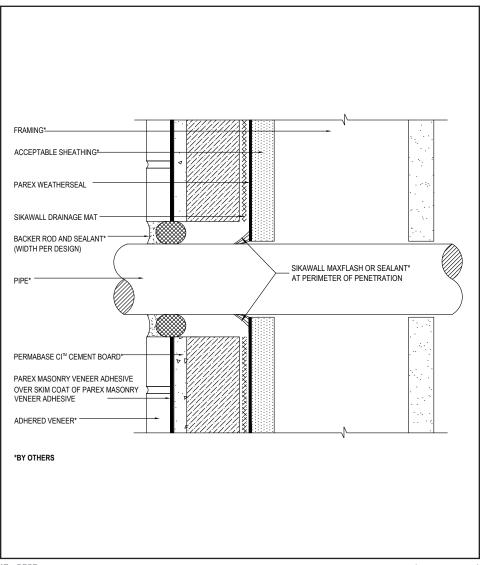

- Ensure all penetrations into the system are properly sealed.
- Provide continuous air seal around perimeter of penetration prior to SikaWall Drainage Mat application.


17 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL SIGN ATTACHMENT

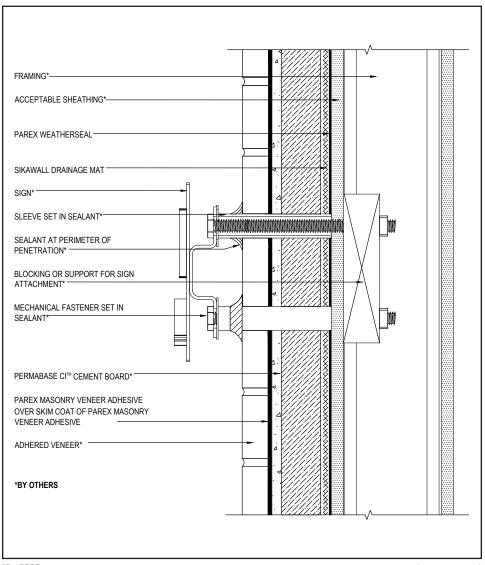

• Ensure all fastener penetrations through the system are properly sealed.


18 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### **TYPICAL OUTSIDE CORNER MITER DETAIL (PLAN VIEW)**

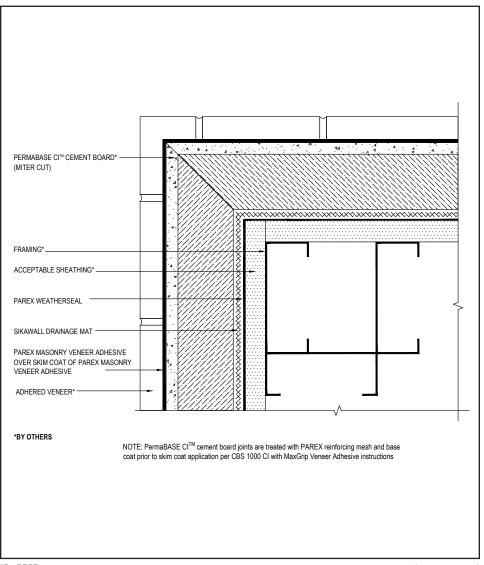

 PermaBase CI cement board joints must be treated with Parex reinforcing mesh and base coat prior to skim coat application of Parex Masonry Veneer Adhesive.


19 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL OUTSIDE CORNER DETAIL RABBET JOINT (PLAN VIEW)

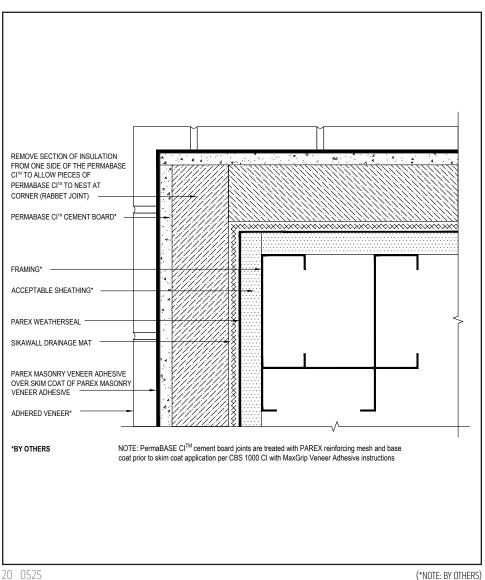


• PermaBase CI cement board joints must be treated with Parex reinforcing mesh and base coat prior to skim coat application of Parex Masonry Veneer Adhesive.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL INSIDE CORNER DETAIL

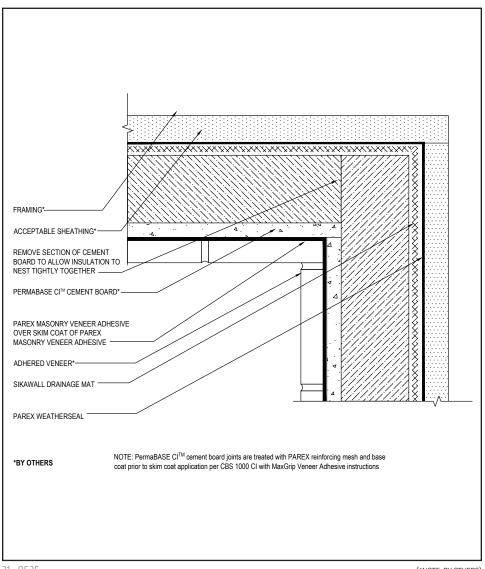

 PermaBase CI cement board joints must be treated with Parex reinforcing mesh and base coat prior to skim coat application of Parex Masonry Veneer Adhesive.

21 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### **TYPICAL FASCIA/SOFFIT**

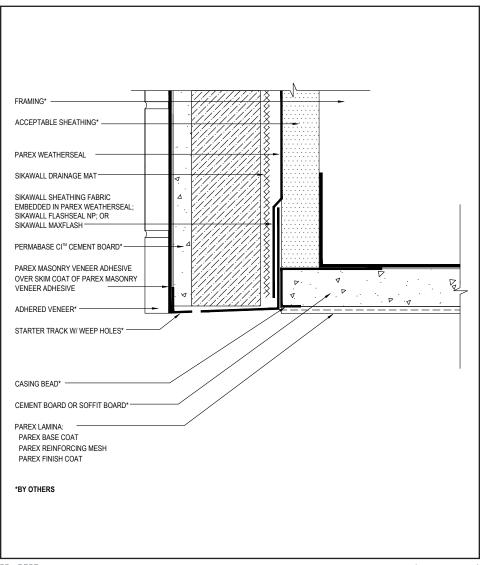

- Ensure a means for drainage is provided at system termination at soffit.
- Extend WeatherSeal a minimum of 4"
   (100mm) onto soffit. If necessary for air barrier
   continuity WeatherSeal can be applied over
   entire soffit.
- Reference Parex Finishing System for Soffits and Ceilings published literature for additional information.
- Note that Parex Masonry Veneer Adhesive is not for use on overhead application.

22 0525 (\*NOTE: BY OTHERS)


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







#### TYPICAL TERMINATION AT FOUNDATION

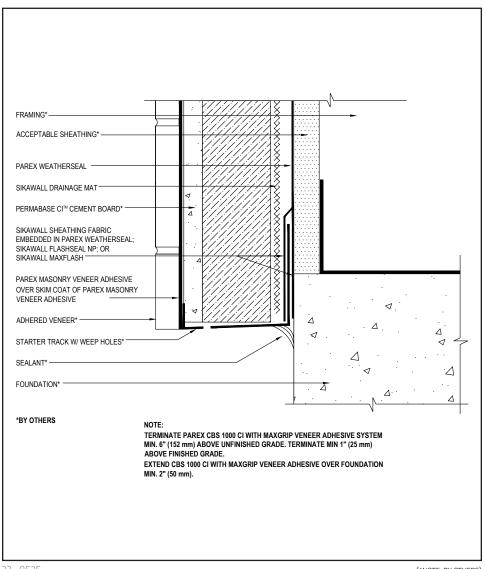

- Terminate the NuTech Stucco MVS CI system a minimum of 6" (152 mm) above raw earth and 1" (25 mm) above paved surface.
- Provide a minimum 2" (50 mm) overlap at framing/foundation transition.
- Ensure casing/stop bead includes weep holes to facilitate drainage.


23 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL METAL COPING DETAIL

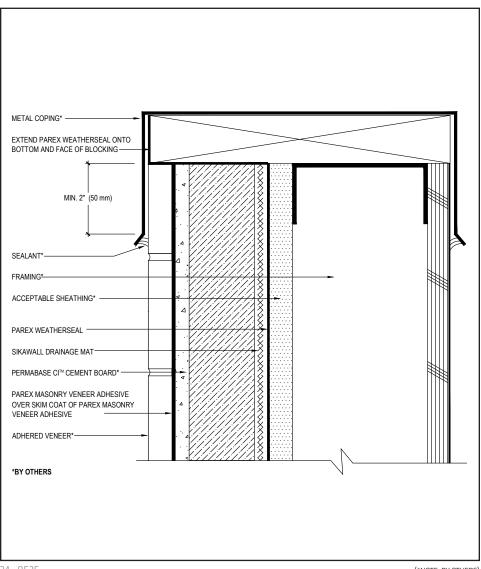

- Ensure that coping/ flashing extends over the system a minimum of 2" (50 mm).
- Extend the Parex air/water-resistive barrier on to the bottom and face of blocking.


24 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL TERMINATION ABOVE FLAT ROOF

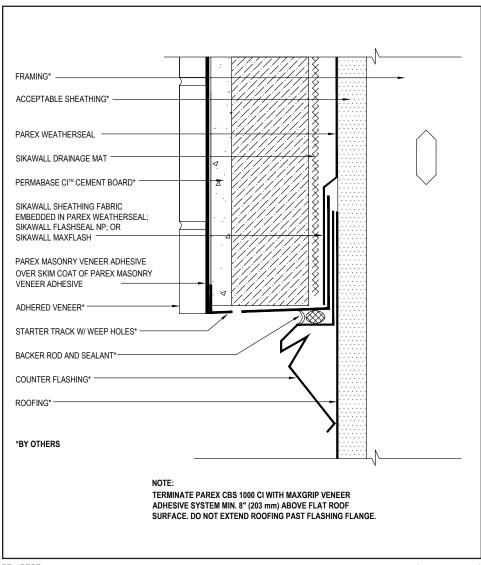

- Ensure a means for drainage is provided at system termination.
- Terminate system a minimum of 8" (203 mm) above flat roof. Roofing material shall not extend above the flashing flange.

25 0525 (\*NOTE: BY OTHERS)

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





#### LIMITED WARRANTY NOTICE

Prior to each use of any product of Sika Corporation, its subsidiaries or affiliates ("SIKA"), the user must always read and follow the warnings and instructions on the product's most current product label, Product Data Sheet and Safety Data Sheet which are available at usa.sika.com/parex or by calling our Technical Service Department at +1 (800) 226-2424.

Nothing contained in any SIKA literature or materials relieves the user of the obligation to read and follow the warnings and instructions for each SIKA product as set forth in the current product label, Product Data Sheet and Safety Data Sheet prior to use of the SIKA product.

SIKA warrants this product for one year from date of installation to be free from manufacturing defects and to meet the technical properties on the current Product Data Sheet if used as directed within the product's shelf life. User determines suitability of product for intended use and assumes all risks. User's and/ or buyer's sole remedy shall be limited to the purchase price or replacement of this product exclusive of any labor costs. NO OTHER WARRANTIES EXPRESS OR IMPLIED SHALL APPLY INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SIKA SHALL NOT BE LIABLE UNDER ANY LEGAL THEORY FOR SPECIAL OR CONSEQUENTIAL DAMAGES. SIKA SHALL NOT BE RESPONSIBLE FOR THE USE OF THIS PRODUCT IN A MANNER TO INFRINGE ON ANY PATENT OR ANY OTHER INTELLECTUAL PROPERTY RIGHTS HELD BY OTHERS. Sale of SIKA products are subject to the Terms and Conditions of Sale which are available at usa.sika.com.

For the most current version of this literature, please visit our website at usa.sika.com/parex.

Sika Corporation
201 Polito Avenue
Lyndhurst, NJ 07071 USA
Customer Service +1 (800) 433-9517
Technical Service +1 (800) 226-2424
usa.sika.com/parex Rev May 2025

