

A Systems Approach to the Building Enclosure Typical Details





## Pebbletex CI-DCA Details

### Typical Details

#### **Table of Contents**

- 1. Channeled Adhesive Pattern
- 2. Application over Framing
- 3. Application over CMU
- 4. Application over Brick
- 5. Application with High Impact Reinforcing Mesh
- Corner Mesh Application With Standard Mesh, Intermediate 6 or 12
- 7. Aesthetic Reveal
- 8. Decorative Shape Application
- 9. Expansion Joint
- 10. Expansion Joint at Change In Substrate
- 11. Expansion Joint at Floorline
- 12. Drainage at Floorline
- 13. Abutment To Brick With Flashing
- 14. Typical Abutment To Brick With Continuous Drainage Plane
- 15. Termination at Foundation
- 16. Termination at Foundation (Flush)
- 17. Termination at Balcony Deck
- 18. Window Head (Flush)
- 19. Window Head with Weep Tubes (Flush)
- 20. Window Head with Diverter Track (Flush)

- 21. Window Head with Sealant End Dam
- 22. Window Jamb (Flush)
- 23. Window Sill (Flush)
- 24. Window Head (Recessed)
- 25. Window Jamb (Recessed)
- 26. Window Sill (Recessed)
- 27. Flanged Window Head
- 28. Flanged Window Jamb
- 29. Flanged Window Sill
- 30. Fascia to Direct Applied Soffit
- 31. Fascia to Insulated Soffit
- 32. Pipe Penetration
- 33. Light Fixture
- 34. Core Mounted Railing Attachment
- 35. Raining Attachment
- 36. Sign Attachment
- 37. Coping
- 38. EPS Parapet Cap
- 39. Termination to Flat Roof
- 40. Kick-Out Flashing at Sloped Roof
- 41. Roof Edge Flashing


#### Notes:

- The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The
  details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown,
  consult Sika for review of specific details.
- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





#### TYPICAL CHANNELED ADHESIVE PATTERN

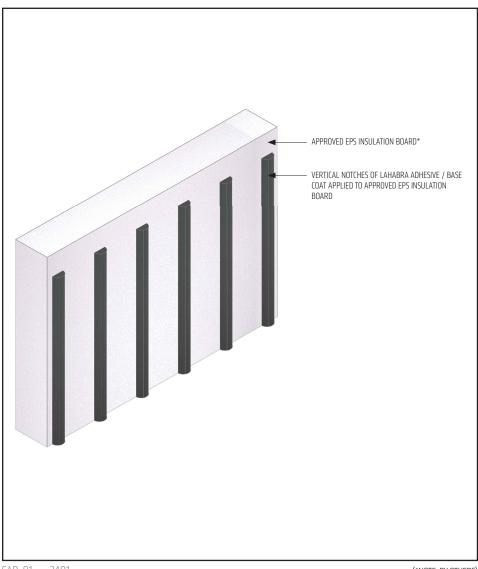

- Apply mixed LaHabra Adhesive/Base Coat
  to entire surface of insulation board using a
  stainless steel trowel with 1/2" x 1/2" (13 mm
  x 13 mm) notches spaced 2" (50 mm) apart.
  Ribbons of adhesive must be applied parallel
  to the 2' (610 mm) dimension of the EPS
  insulation board to ensure they are vertical
  when the EPS insulation board is applied to the
  substrate.
- Set EPS insulation board into place and apply pressure over entire surface of board to ensure positive uniform contact and high initial grab.
   Do not slide board into place.

CAD-01 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







#### TYPICAL APPLICATION OVER FRAMING

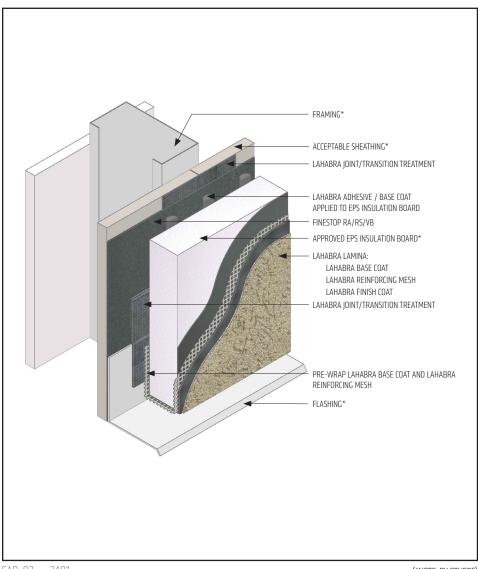

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination.
- LaHabra Joint/Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

CAD-02 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## **Pebbletex CI-DCA**

### TYPICAL APPLICATION OVER CMU

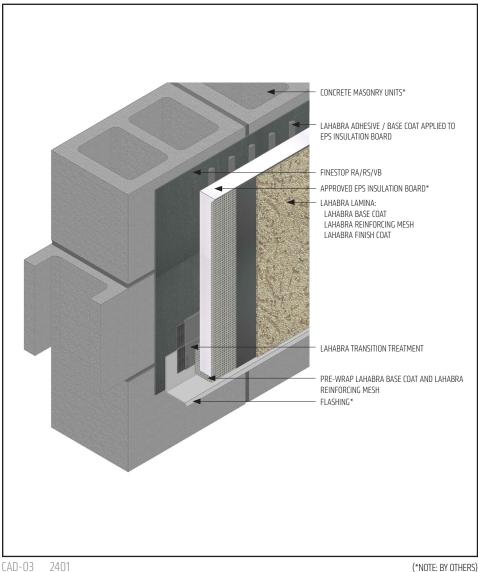

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation
- Ensure a means for drainage is provided at system termination.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL APPLICATION OVER BRICK

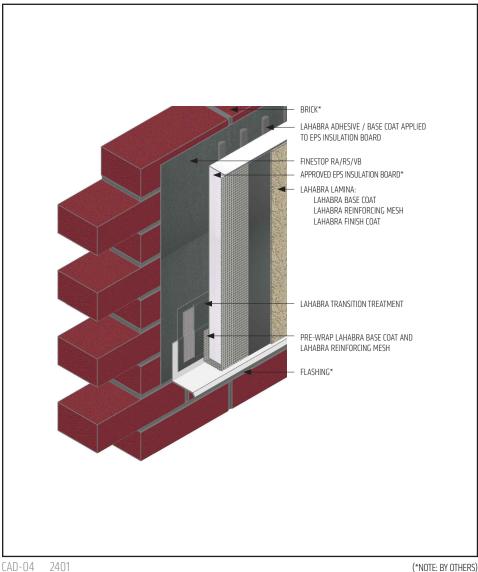

- All terminations must be fully encapsulated with mesh reinforced base coat. Pre-backwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.

**Customer Service** 





### TYPICAL APPLICATION WITH HIGH IMPACT REINFORCING MESH

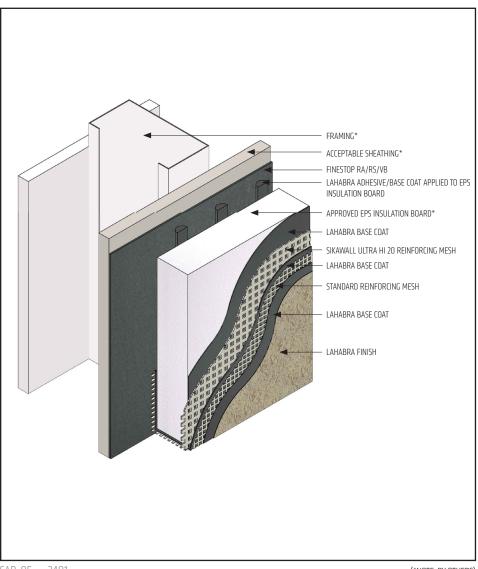

- Use of SikaWall Ultra HI 20 reinforcing mesh is recommend at the ground floor in high traffic areas and in areas exposed to potential for high impact.
- Butt SikaWall Ultra HI 20 reinforcing mesh at all adjoining edges including corners, do not use to backwrap or bend around corners.
- All terminations must be fully encapsulated with mesh reinforced base coat.
- SikaWall Ultra HI 20 and Standard reinforcing mesh are embedded in two separate layers of base coat. Allow the first base coat layer with Ultra HI 20 Reinforcing Mesh to dry prior to application of the second base coat layer with Standard Reinforcing Mesh.

CAD-05 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### **TYPICAL CORNER MESH APPLICATION** WITH STANDARD MESH, INTERMEDIATE 6 OR 12

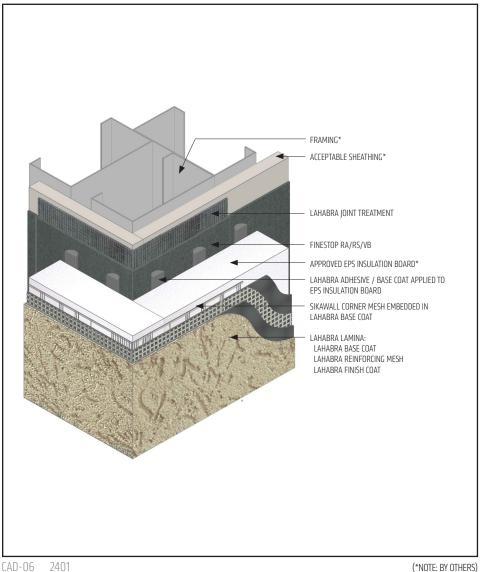

- Ensure Standard, SikaWall Intermediate 6 or SikaWall Intermediate 12 Reinforcing Mesh is lapped a minimum of 8" (203 mm) around corners.
- SikaWall Corner Mesh on outside corner can be replaced, with Standard, SikaWall Intermediate 6 or SikaWall Intermediate 12, extended a minimum of 8" (203 mm) around corner from both sides (creating double layer of mesh at
- LaHabra Joint Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.


The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.



## **Pebbletex CI-DCA**

### TYPICAL AESTHETIC REVEAL

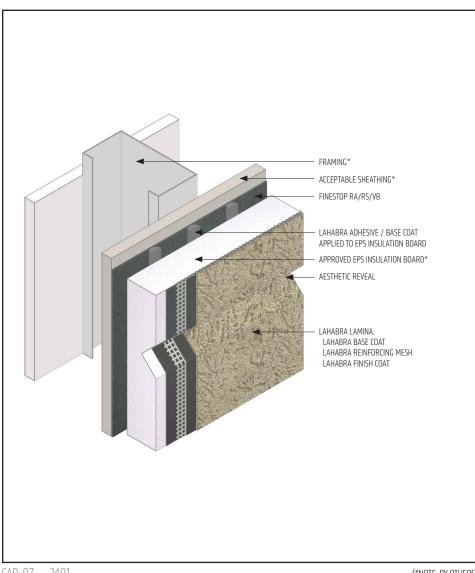

- Maintain a continuous layer of EPS insulation board, at a minimum 3/4" (19 mm) thickness, behind all reveals and aesthetic grooves.
- Reinforcing mesh shall be continuous and care shall be taken to ensure reinforcing mesh is not cut during base coat application.
- Horizontal reveals shall provide for outward positive drainage.
- Reveals must not occur at the abutment of two pieces of EPS insulation board.

CAD-07 2401 (\*NOTE: BY OTHERS)


The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





### TYPICAL DECORATIVE SHAPE APPLICATION

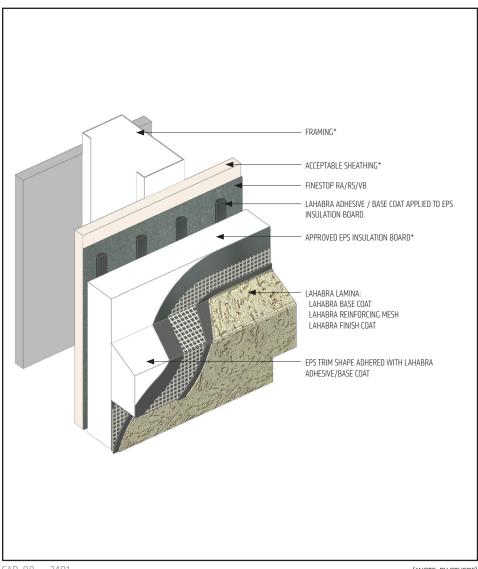

- On horizontal projections greater than 1" (25mm) maintain a minimum 6:12 slope. For sloped surfaces over 24" (340mm), a roofing system or a metal cap flashing is required.
- LaHabra Joint Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

2401 CAD-08 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## **Pebbletex CI-DCA**

### **TYPICAL EXPANSION JOINT**

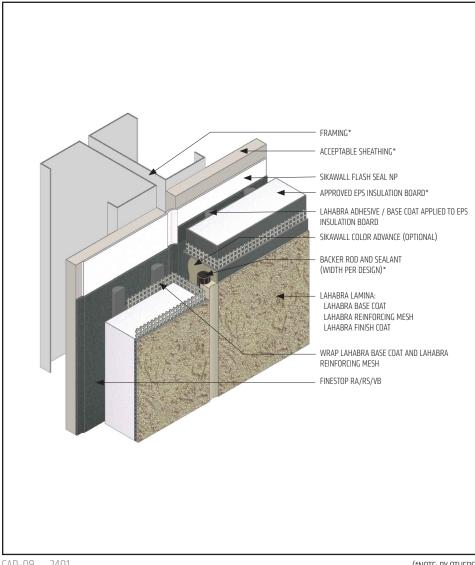

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Do not apply finish to areas that will receive sealant.
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Typical locations for system expansion joints are at building expansion joints, at prefabricated panel joints, floor lines of wood frame construction or where slip tracks are used in steel frame construction, where substrates change and where structural movement is anticipated. It is the sole responsibility of the project design team, including the architect, engineer, etc., to ultimately determine specific expansion joint placement, width and design. Detail specific locations in construction drawings
- Provide sufficient slack in SikaWall Flash Seal NP at expansion joint to allow for movement.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-09 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL EXPANSION JOINT AT CHANGE IN SUBSTRATE

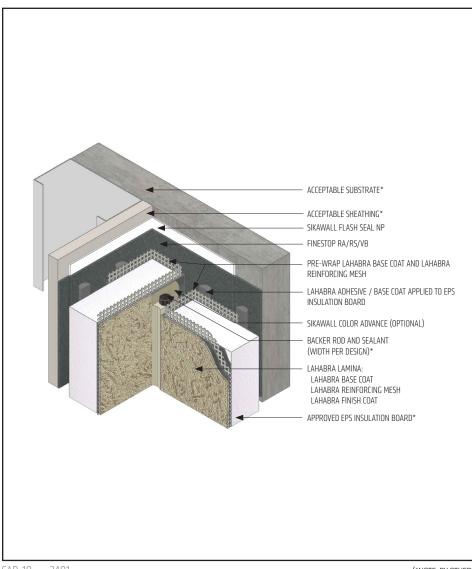

- · All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Do not apply finish to areas that will receive sealant.
- · Ensure drainage plane is continuous and unobstructed at expansion joint.
- Typical locations for system expansion joints are at building expansion joints, at prefabricated panel joints, floor lines of wood frame construction or where slip tracks are used in steel frame construction, where substrates change and where structural movement is anticipated. It is the sole responsibility of the project design team, including the architect, engineer, etc., to ultimately determine specific expansion joint placement, width and design. Detail specific locations in construction drawings.
- Provide sufficient slack in SikaWall Flash Seal NP at expansion joint to allow for movement.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-10 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### TYPICAL EXPANSION JOINT AT FLOORLINE

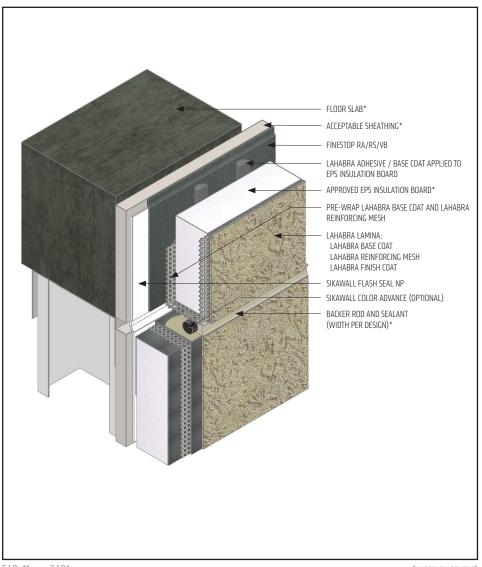

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Do not apply finish to areas that will receive sealant.
- · Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for
- Typical locations for system expansion joints are at building expansion joints, at prefabricated panel joints, floor lines of wood frame construction or where slip tracks are used in steel frame construction, where substrates change and where structural movement is anticipated. It is the sole responsibility of the project design team, including the architect, engineer, etc., to ultimately determine specific expansion joint placement, width and design. Detail specific locations in construction drawings.
- · It is recommended that a means for drainage is provided at every third floor. (See typical drainage at floorline detail).
- Ensure drainage plane is continuous and unobstructed at expansion joint.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-11 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.

Technical Service


**Sika Corporation** 





## Pebbletex CI-DCA

### TYPICAL DRAINAGE AT FLOORLINE

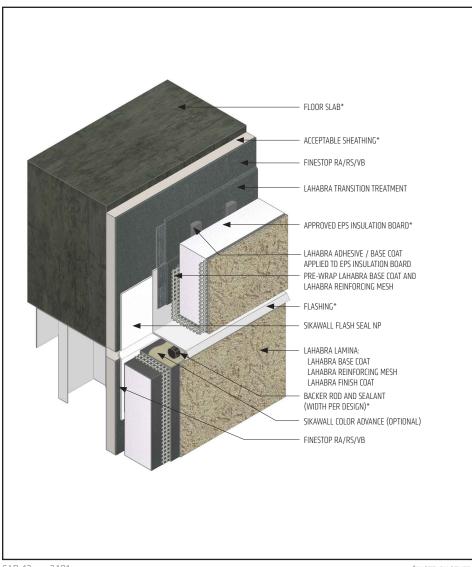

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation hoard.
- Do not apply finish to areas that will receive sealant.
- Typical locations for system expansion joints are at building expansion joints, at prefabricated panel joints, floor lines of wood frame construction or where slip tracks are used in steel frame construction, where substrates change and where structural movement is anticipated. It is the sole responsibility of the project design team, including the architect, engineer, etc., to ultimately determine specific expansion joint placement, width and design. Detail specific locations in construction drawings.
- It is recommended that a means for drainage is provided at every third floor.
- · Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for Use With Sika Facades Technical Bulletin for a list of sealants.

CAD-12 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 







### TYPICAL ABUTMENT TO BRICK WITH FLASHING

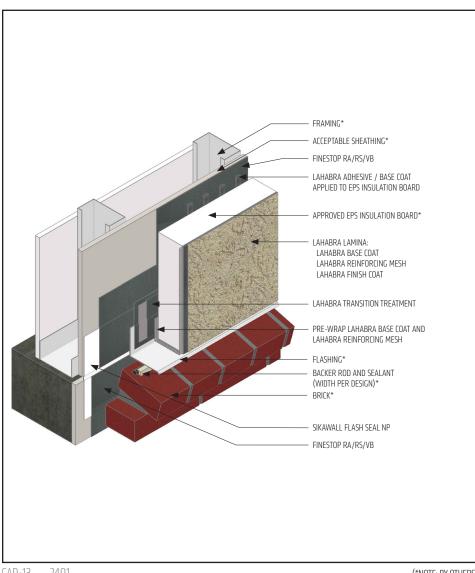

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at brick.
- Brick must be installed per local code requirements.
- · Provide sufficient slack in the SikaWall Flash Seal NP at expansion join to allow for movement.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

CAD-13 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### **TYPICAL ABUTMENT TO BRICK** WITH CONTINUOUS DRAINAGE PLANE

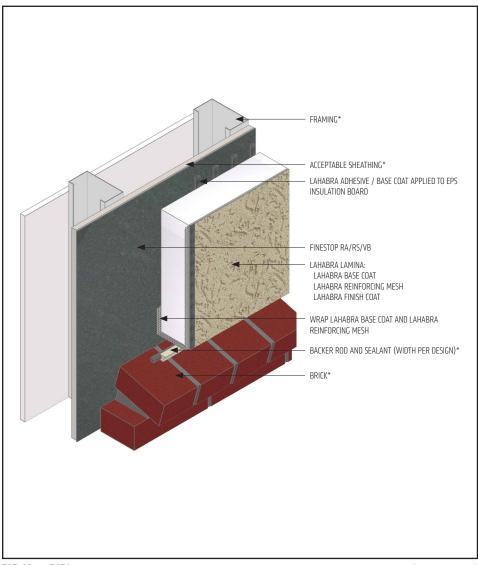

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure a continuous drainage plane is maintained at system abutment to brick.
- Brick must be installed per local code requirements.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-14 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### TYPICAL TERMINATION AT FOUNDATION

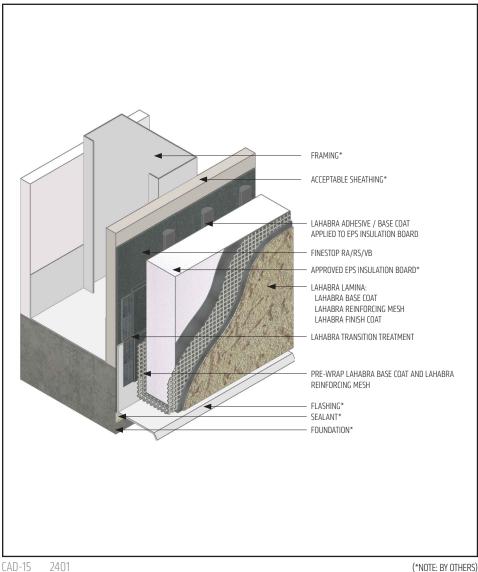

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at foundation.
- Terminate system a minimum of 6" (152 mm) above grade.
- Extend system a minimum of 2" (50 mm) and a maximum of 12" (305 mm) at the sole plate foundation transition.
- Apply LaHabra Transition Treatment at transition from sheathing to concrete (behind
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## **Pebbletex CI-DCA**

### **TYPICAL TERMINATION AT FOUNDATION (FLUSH)**

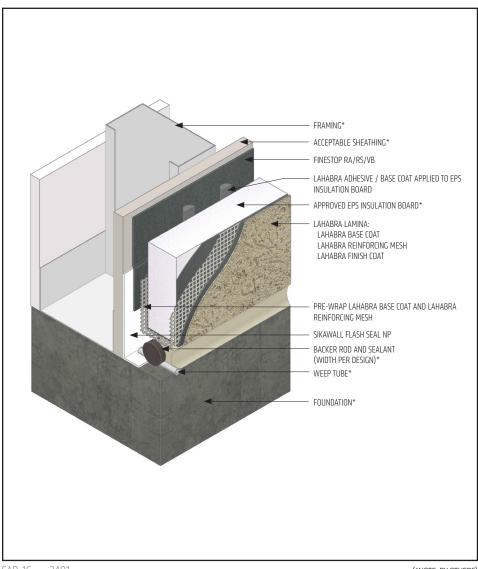

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at foundation.
- Place weep tubes a maximum of 24" (610 mm) on center.
- Do not apply finish to areas that will receive sealant.
- Reference Acceptable Sealants for use with LaHabra Wall System Technical Bulletin for a list of sealants.

CAD-16 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## **Pebbletex CI-DCA**

#### TYPICAL TERMINATION AT BALCONY DECK

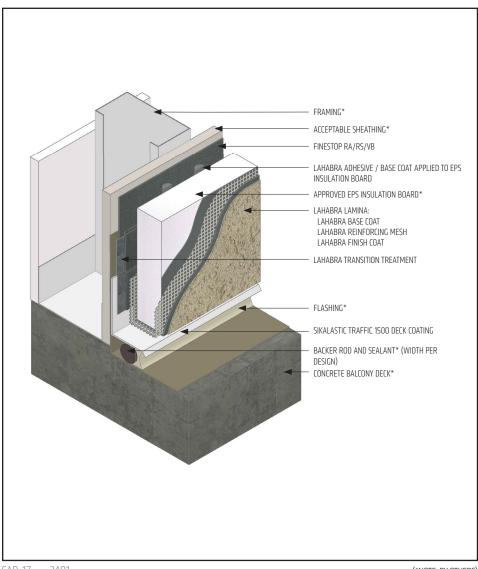

- For traffic/deck coating other than Sikalastic® Traffic 1500, ensure flashing flange fully covers the traffic/deck coating material prior to transitioning LaHabra materials onto the flange.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.

CAD-17 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### **TYPICAL WINDOW HEAD (FLUSH)**

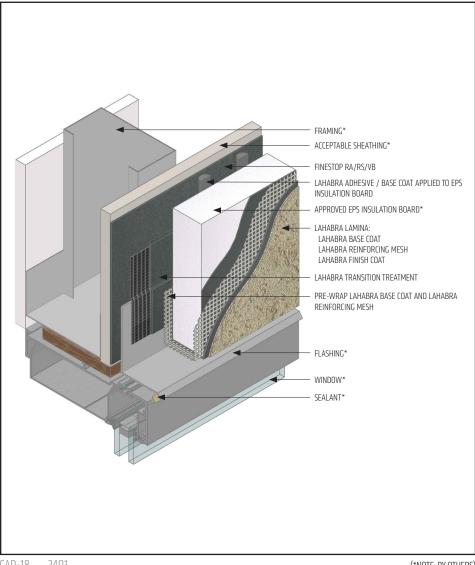

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at window head.
- Provide end-dams at flashing terminations.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-18 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### **TYPICAL WINDOW HEAD (FLUSH) WITH WEEP TUBES**

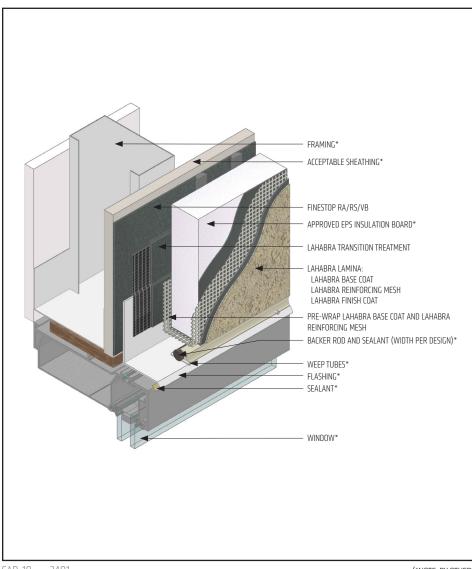

- · All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at window head.
- Provide end-dams at flashing terminations.
- Do not apply finish to areas that will receive sealant.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical
- Place weep tubes a maximum of 16" (406 mm) on center.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- · Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-19 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### TYPICAL WINDOW HEAD (FLUSH) WITH DIVERTER TRACK

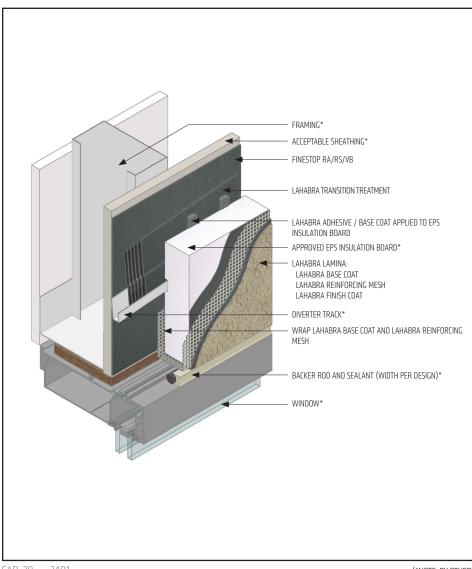

- · All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board
- · Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- Diverter Flashing Requirements:
- Extend diverter flashing 6" (152 mm) beyond opening on either side of the opening to allow potential moisture to drain down the wall to the side of the opening.
- Ensure the flashing is in one piece and does not exceed 10 ft.
- Ensure the diverter track flashing is sloped 1-2" to provide a means for drainage.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Maintain a minimum of 3/4" (19 mm) EPS insulation thickness.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical details.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Do not apply finish in areas that will receive
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

**Customer Service** 

Technical Service

CAD-20 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL WINDOW HEAD WITH SEALANT END DAM

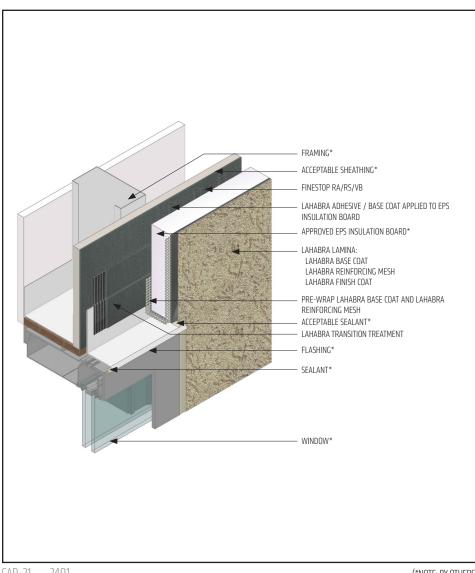

- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Do not apply finish in areas that will receive
- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.

CAD-21 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### **TYPICAL WINDOW JAMB (FLUSH)**

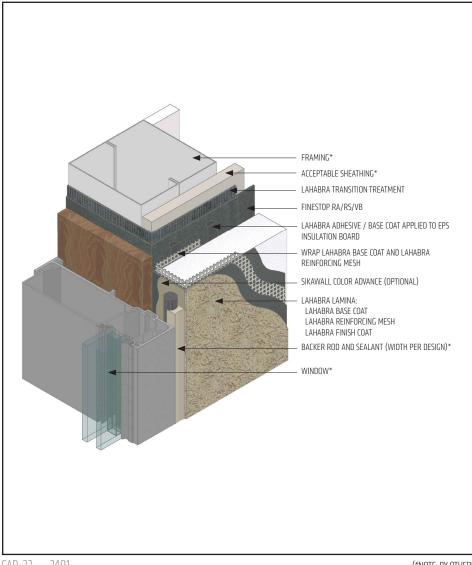

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements.
   Reference LaHabra Finestop published typical details for further information.
- Do not apply finish to areas that will receive sealant.
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- LaHabra Transition Treatment Options:
   SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-22 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### **TYPICAL WINDOW SILL (FLUSH)**

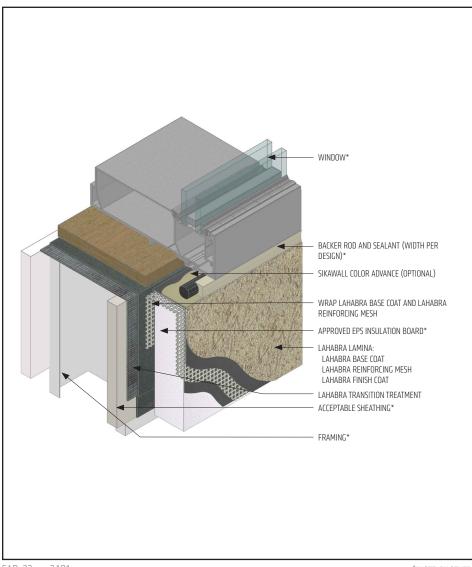

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical
- Do not apply finish to areas that will receive
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-23 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## **Pebbletex CI-DCA**

### **TYPICAL WINDOW HEAD (RECESSED)**

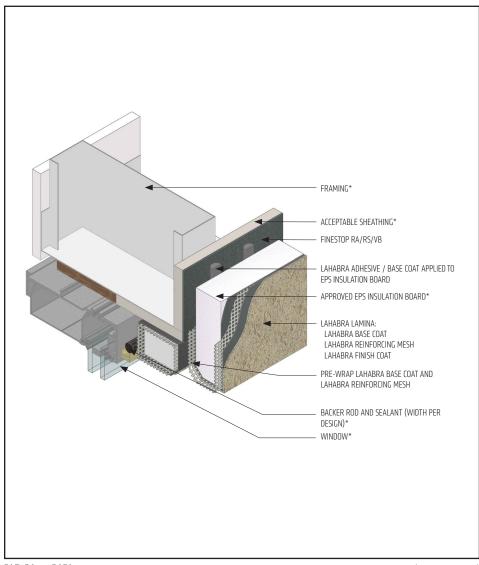

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum 21/2" onto back of insulation board.
- Do not apply finish to areas that will receive sealant.
- Ensure a means for drainage is provided at system termination at window head.
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements.
   Reference LaHabra Finestop published typical details for further information.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.
- Reference Acceptable Sealants for Use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-24 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### **TYPICAL WINDOW JAMB (RECESSED)**

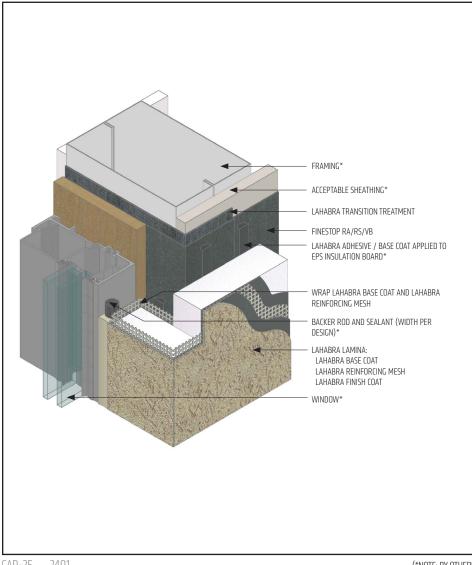

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements.
   Reference LaHabra Finestop published typical details for further information.
- Do not apply finish to areas that will receive sealant.
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- LaHabra Transition Treatment Options: SikaWall Flash Seal MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall NP
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-25 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### **TYPICAL WINDOW SILL (RECESSED)**

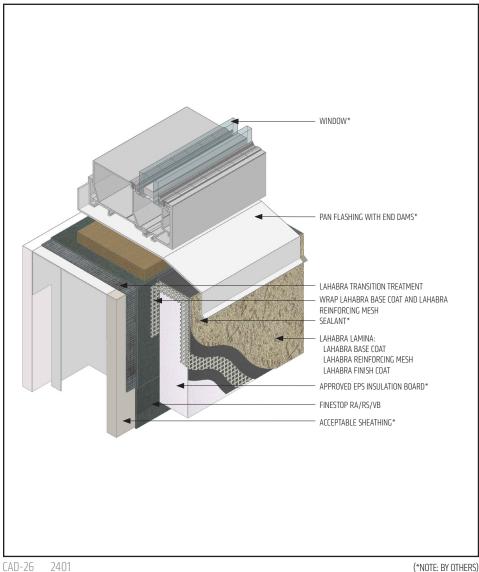

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure water-resistive barrier is properly applied into the rough openings in accordance with application guidelines and code requirements prior to EPS insulation board application.
- Ensure that metal pan flashing extends onto the system a minimum of 2" (50 mm) down the face and that end dams are provided.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## Pebbletex CI-DCA

### TYPICAL FLANGED WINDOW HEAD

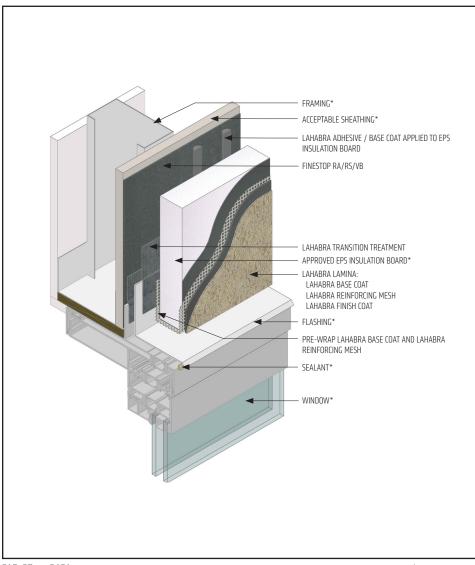

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure the window flange is treated with a LaHabra transition treatment.
- Ensure a means for drainage is provided at system termination at window head.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical details for further information.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-27 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## **Pebbletex CI-DCA**

### **TYPICAL FLANGED WINDOW JAMB**

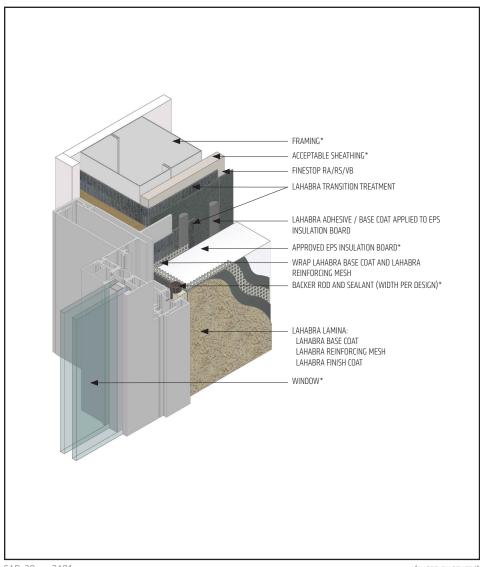

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure the window flange is treated with a LaHabra transition treatment.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Do not apply finish to areas that will receive sealant.
- Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical details.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall assembly.

CAD-28 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

#### TYPICAL FLANGED WINDOW SILL

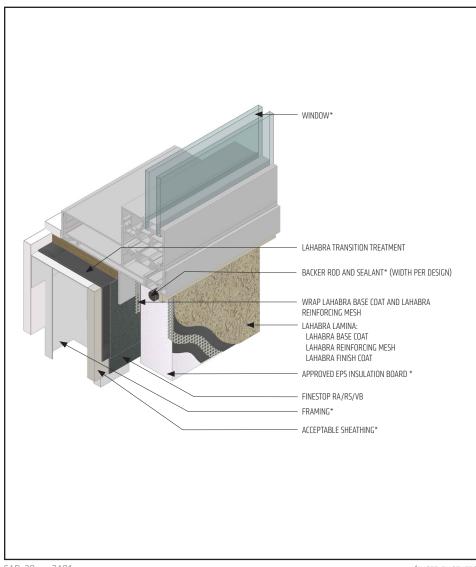

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- · Ensure the window flange is left untreated for drainage.
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Prior to window and EPS installation, ensure water-resistive barrier is properly applied into the rough openings in accordance with LaHabra application guidelines and code requirements. Reference LaHabra Finestop published typical
- Do not apply finish to areas that will receive sealant.
- · Provide a back wrapped type joint with backer rod and sealant at system terminations to dissimilar materials, ensuring that a water tight seal is achieved (width per design).
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Consult window and sealant manufacturers to verify window installation, detailing and to ensure no water leakage into the wall

CAD-29 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## **Pebbletex CI-DCA**

### TYPICAL FASCIA TO DIRECT APPLIED SOFFIT

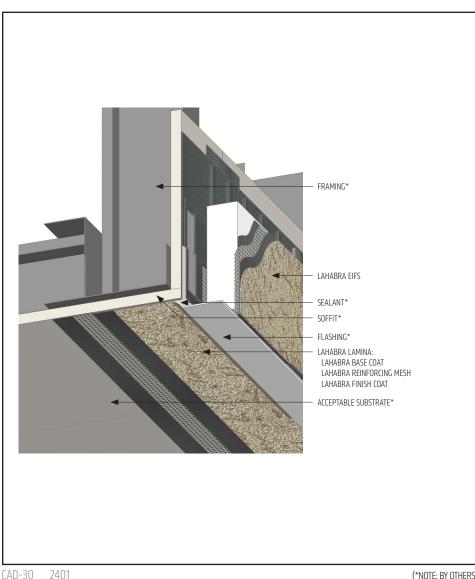

- · Verify substrate is flat, free of fins or planar irregularities greater than 1/4" in 10".
- Install wall system first followed by lamina application at soffit.
- Ensure a means for drainage is provided at system termination at soffit.
- Extend flashing slightly below the level of the soffit to provide a surface for sealant application.
- Extend Finestop RA/RS/VB a minimum of 4" (100mm) onto soffit. If necessary for air barrier continuity Finestop RA/RS/VB can be applied over entire soffit.
- Reference LaHabra Finishing System for Soffits and Ceilings published literature for additional information.

CAD-30 (\*NOTE: BY OTHERS)


The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.



## **Pebbletex CI-DCA**

### TYPICAL FASCIA TO INSULATED SOFFIT

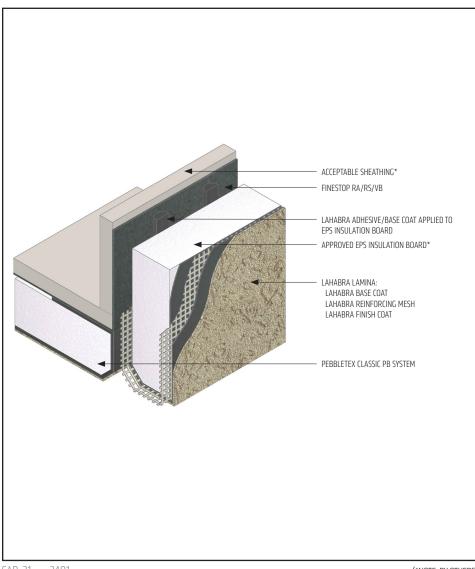

- All terminations must be fully encapsulated with mesh reinforced base coat. Pre-backwrap both the vertical and horizontal terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Extend Finestop RA/RS/VB a minimum of 4" (100mm) onto soffit. If necessary for air barrier continuity Finestop RA/RS/VB can be applied over entire soffit.
- Ensure a means of drainage is provided at system termination at soffit/fascia transition.

2401 CAD-31 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Customer Service** 





## **Pebbletex CI-DCA**

### TYPICAL PIPE PENETRATION

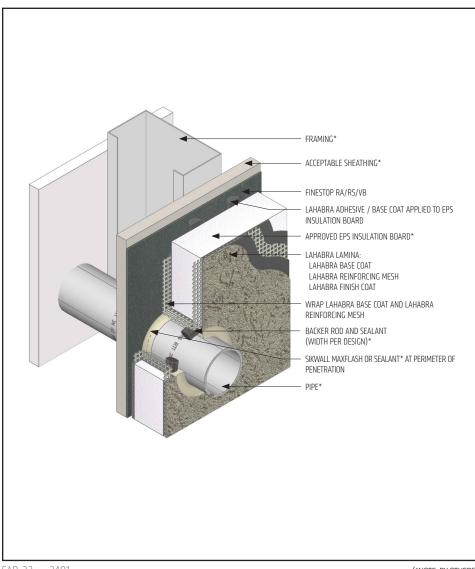

- All terminations must be fully encapsulated with mesh reinforced basecoat. Pre-backwrap both the vertical and horizontal terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- · Ensure all penetrations into the system are properly sealed. Reference Acceptable Sealants to use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Provide continuous air seal around perimeter of penetration prior to EPS insulation board application. Reference Acceptable Sealants for use with Finestop RA/RS/VB Technical Bulletin for a list of sealants.
- Do not apply finish to areas that will receive sealant.

CAD-32 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.





## Pebbletex CI-DCA

### TYPICAL LIGHT FIXTURE

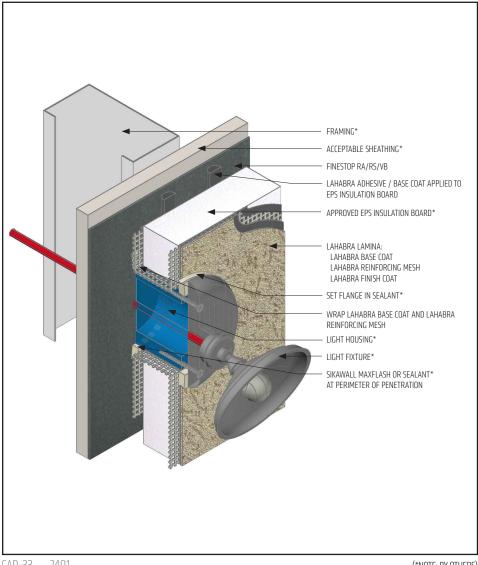

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrap both the vertical and horizontal terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure all penetrations into the system are properly sealed.
- Reference Acceptable Sealants to use with LaHabra Wall Systems Technical Bulletin for a list of sealants.
- Provide continuous air seal around perimeter of penetration prior to EPS insulation board application. Reference Acceptable Sealants for use with Finestop RA/RS/VB Technical Bulletin for a list of sealants.

CAD-33 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.


- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.







### TYPICAL CORE MOUNTED RAILING ATTACHMENT

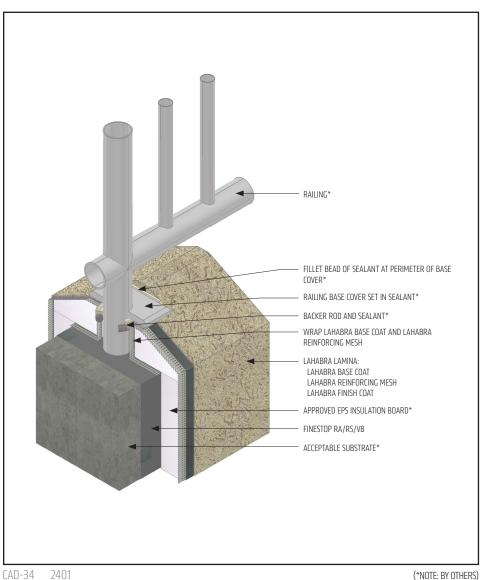

- All terminations must be fully encapsulated with mesh reinforced base coat. Pre-backwrap both the vertical and horizontal terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure all penetrations into the system are properly sealed.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

(\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.


**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.



## **Pebbletex CI-DCA**

### TYPICAL RAILING ATTACHMENT

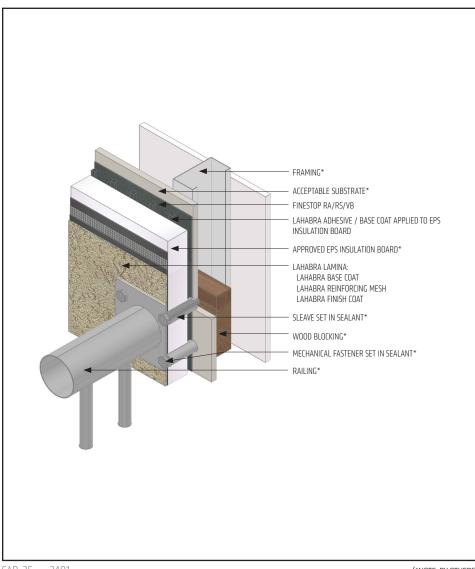

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure all penetrations into the system are properly sealed.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-35 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.

Customer Service

Technical Service


**Sika Corporation** 





## **Pebbletex CI-DCA**

### **TYPICAL SIGN ATTACHMENT**

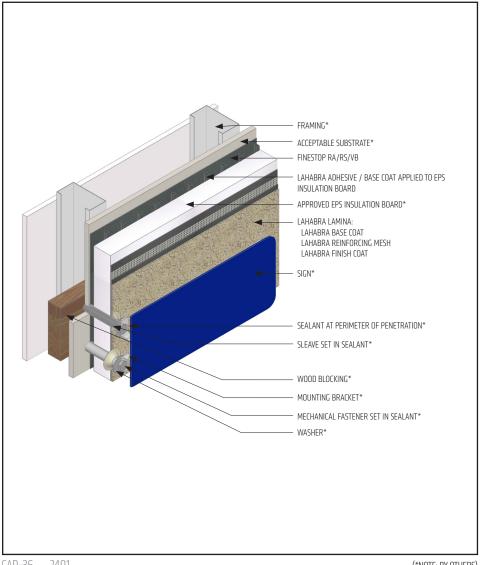

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure all penetrations into the system are properly sealed.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

2401 CAD-36 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.


**Sika Corporation** 

• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.



## **Pebbletex CI-DCA**

### **TYPICAL COPING**

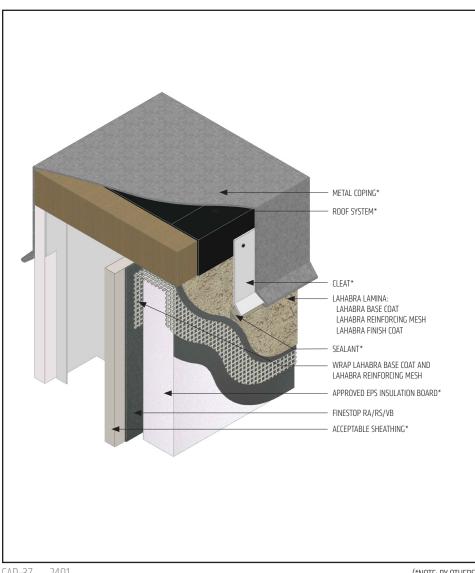

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure that metal coping/ flashing extends onto the system a minimum of 2" (50 mm) down the face.
- Extend Finestop RA/RS/VB or SikaWall MaxFlash onto bottom of blocking or provide alternate air seal at sheathing termination to blocking.
- Reference *Acceptable Sealants for use with LaHabra Wall Systems* Technical Bulletin for a list of sealants.

CAD-37 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


**Sika Corporation** 





## Pebbletex CI-DCA

#### TYPICAL WITH EPS PARAPET CAP

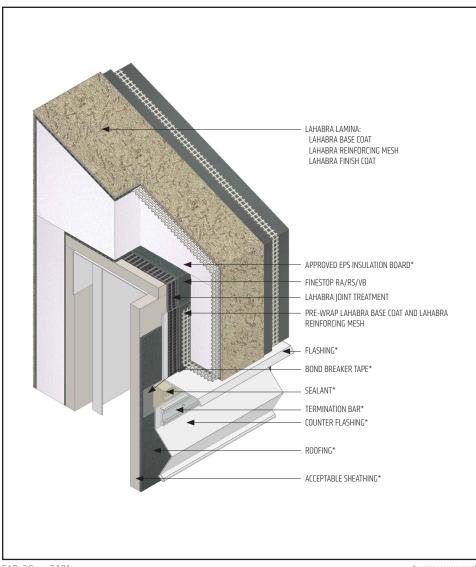

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Provide a minimum 6:12 slope for all horizontal surfaces. LaHabra requires the use of a roofing system or metal cap flashing for sloped surfaces over 24" (610 mm).
- · Additional layers of mesh reinforced base coat is recommended when sloped surfaces exceed 12" (305 mm).
- Ensure a means for drainage is provided at system termination.
- Terminate system a minimum of 8" (203 mm) above flat roof. Roofing material shall not extend above the flashing flange.
- Maintain a minimum 1" (25 mm) thick EPS insulation board.
- LaHabra Joint Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-38 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

• Install Sika materials in accordance with current installation instructions.

**Sika Corporation** 


• Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.

**Customer Service** 





### TYPICAL TERMINATION TO FLAT ROOF

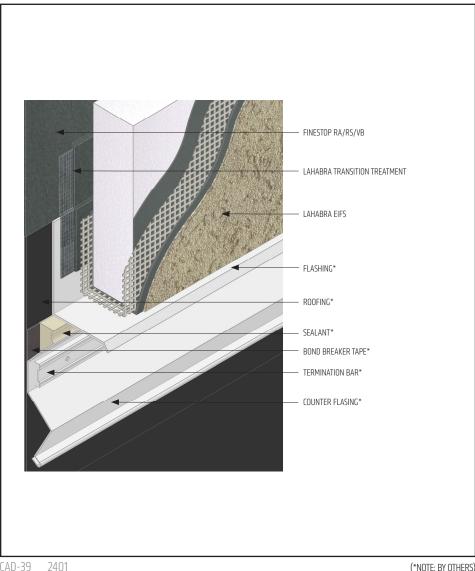

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 21/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination.
- Terminate system a minimum of 8" (203 mm) above flat roof. Roofing material shall not extend above the flashing flange.
- Ensure roofing material terminates behind flashing.

CAD-39 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.


Customer Service





## Pebbletex CI-DCA

### TYPICAL KICK-OUT FLASHING AT SLOPED ROOF

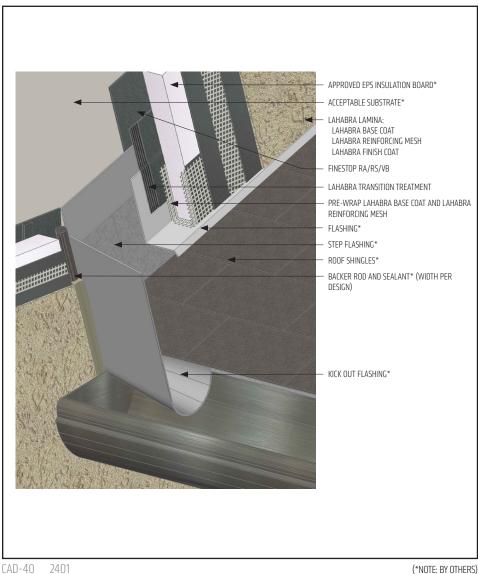

- All terminations must be fully encapsulated with mesh reinforced base coat. Prebackwrapping is recommended at drainage terminations. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure a means for drainage is provided at system termination at roof.
- Terminate system a minimum of 2" (50 mm) above sloped roof.
- Ensure step flashing is a minimum of 2" (50 mm) behind system.
- Kick-out flashing shall be a minimum of 4" (102 mm) in height.
- · Do not apply finish to areas that will receive
- LaHabra Transition Treatment Options: SikaWall MaxFlash, SikaWall Sheathing Fabric embedded in Finestop RA/RS/VB or SikaWall Flash Seal NP.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.


The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.



## **Pebbletex CI-DCA**

### TYPICAL ROOF EDGE FLASHING

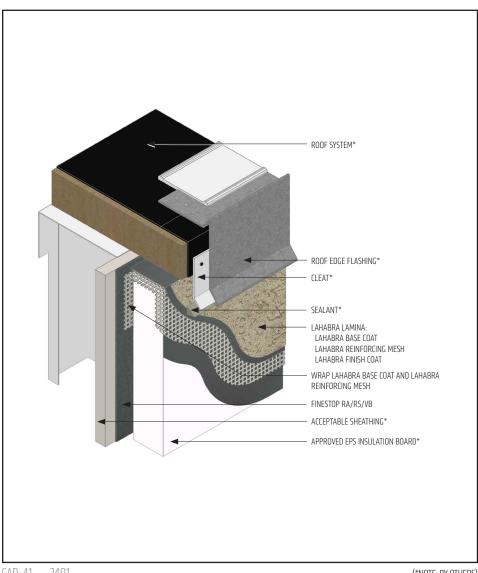

- All terminations must be fully encapsulated with mesh reinforced base coat. Extend reinforcing mesh a minimum of 2 1/2" onto back of insulation board.
- Ensure that metal coping/flashing extends onto the system a minimum of 2" (50 mm) down the face.
- Extend Finestop RA/RS/VB or SikaWall MaxFlash onto bottom of blocking or provide alternate air seal at sheathing termination to blocking.
- Reference Acceptable Sealants for use with LaHabra Wall Systems Technical Bulletin for a list of sealants.

CAD-41 2401 (\*NOTE: BY OTHERS)

The details within are latest recommendations and are represent in good faith by Sika Corporation US (hereinafter Sika). The details are subject to change without notice. Sika accepts no liability for the end use of the details. For conditions not shown, consult Sika for review of specific details.

- Install Sika materials in accordance with current installation instructions.
- Unsatisfactory conditions shall be reported to the General Contractor and corrected before the application of Sika products.

**Customer Service** 





#### LIMITED WARRANTY NOTICE

Prior to each use of any product of Sika Corporation, its subsidiaries or affiliates ("SIKA"), the user must always read and follow the warnings and instructions on the product's most current product label, Product Data Sheet and Safety Data Sheet which are available at usa.sika.com/laHabra or by calling our Technical Service Department at +1 (800) 589-1336.

Nothing contained in any SIKA literature or materials relieves the user of the obligation to read and follow the warnings and instructions for each SIKA product as set forth in the current product label, Product Data Sheet and Safety Data Sheet prior to use of the SIKA product.

SIKA warrants this product for one year from date of installation to be free from manufacturing defects and to meet the technical properties on the current Product Data Sheet if used as directed within the product's shelf life. User determines suitability of product for intended use and assumes all risks. User's and/ or buyer's sole remedy shall be limited to the purchase price or replacement of this product exclusive of any labor costs. NO OTHER WARRANTIES EXPRESS OR IMPLIED SHALL APPLY INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. SIKA SHALL NOT BE LIABLE UNDER ANY LEGAL THEORY FOR SPECIAL OR CONSEQUENTIAL DAMAGES. SIKA SHALL NOT BE RESPONSIBLE FOR THE USE OF THIS PRODUCT IN A MANNER TO INFRINGE ON ANY PATENT OR ANY OTHER INTELLECTUAL PROPERTY RIGHTS HELD BY OTHERS. Sale of SIKA products are subject to the Terms and Conditions of Sale which are available at usa.sika.com.

For the most current version of this literature, please visit our website at usa.sika.com/lahabra.

Sika Corporation
201 Polito Avenue
Lyndhurst, NJ 07071 USA
Customer Service +1 (800) 433-9517
Technical Service +1 (800) 589-1336
usa.sika.com/lahabra

